


SALES DRAWING ONLY  
NOT TO BE USED FOR MANUFACTURE

**CABLE CONNECTIONS**

MODBUS VERSION ICT		
Red	+ Positive	Supply &
Black	- Negative	4-20mA
White	A Data +	RS485 Modbus
Green	B Data -	

HART VERSION ICT		
Red	+ Positive	Supply &
Black	- Negative	4-20mA
A	Connection for HART Communicator	
B		

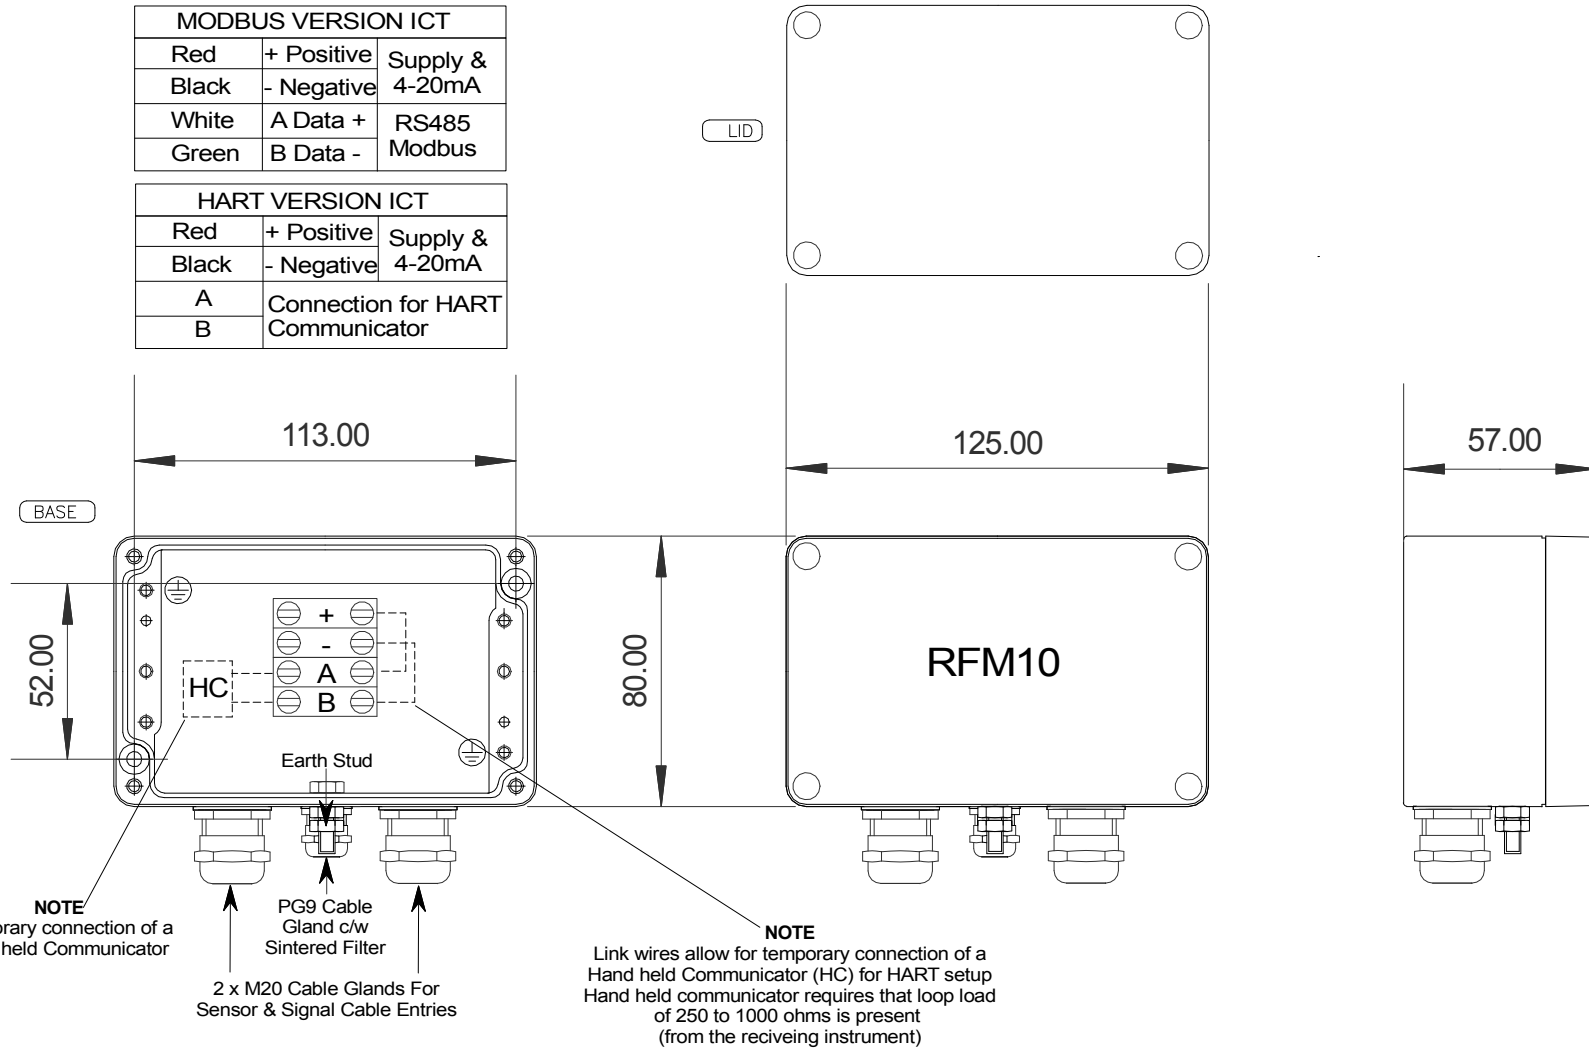

**NOTE**  
Temporary connection of a  
Hand held Communicator

PG9 Cable  
Gland c/w  
Sintered Filter

2 x M20 Cable Glands For  
Sensor & Signal Cable Entries

**NOTE**  
Link wires allow for temporary connection of a  
Hand held Communicator (HC) for HART setup  
Hand held communicator requires that loop load  
of 250 to 1000 ohms is present  
(from the receiving instrument)

Aluminium Enclosure CEA128057 - Rated IP67

**PSM** Instrumentation Ltd

Haywards Heath, West Sussex RH16 1TW  
ph: 44 (0) 1444 410040 f: 44 (0) 1444 410121  
<http://www.psmmarine.com>

ISSUE	A	23-06-14	SAL	MJ
DATE	B	23-06-14	SAL	MJ
DCR	C	15-01-15	SAL	MJ
DRAWN				
CHECKED				

SCALE  
NTS

UNLESS OTHERWISE STATED DIMENSIONS ARE IN  
MILLIMETRES / INCHES

TITLE  
RFM10 Aluminium iCT  
Termination Enclosure

DRAWING NO  
S-001399-iCT-DD

**A4** SHT 1  
OF 1