


Shown with Door removed and VPM4315 omitted

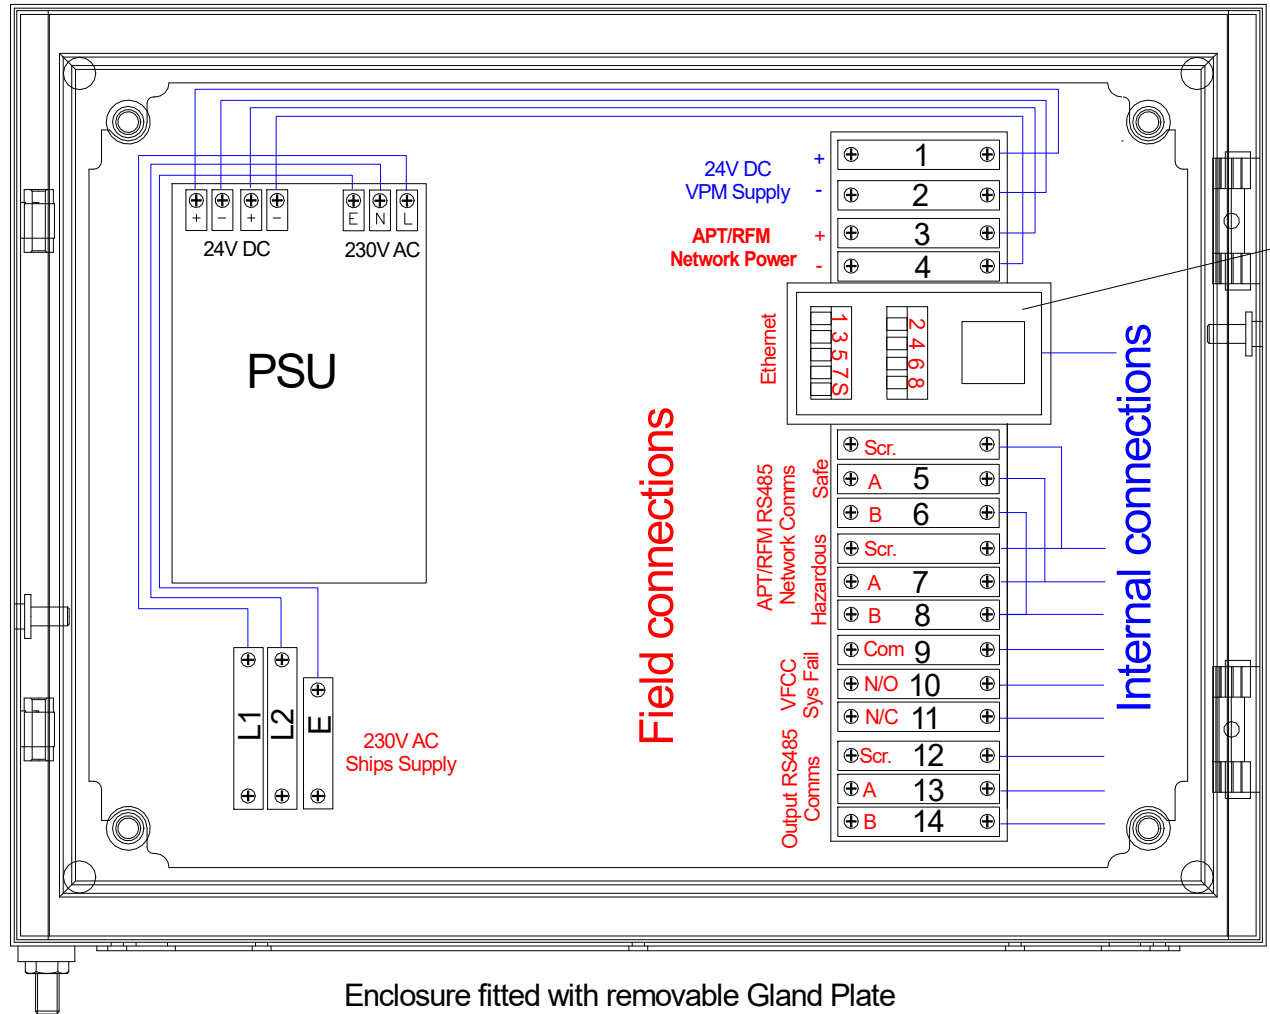

Refer to Sheet 2 for connection detail

Note:
Terminals 9 through to 14 only fitted if System Fail relay and RS485 Output to other systems are enabled

Earth Stud 8mm

Enclosure fitted with removable Gland Plate
Glands to be fitted by installer to suit cabling
All Internal Connections are to VPM 4315 via coded plugs

SCALE
NTS

MATERIAL AND SPECIFICATION

ALL DIMENSIONS ARE IN MILLIMETERS
UNLESS OTHERWISE STATED
TOLERANCES UNLESS OTHERWISE STATED
+/-0.1
ANG +/-2

ISSUE	B
DATE	30-03-21
TCR	
DRAWN	MJ
CHECKED	SL

SHT 1
OF 2

A4




INSTRUMENTATION LTD

PART OF THE GROUP

TITLE
Wall mounting VPM 4315
Connection detail

DRAWING No
S-001508-VPM-CD

SALES DRAWING ONLY

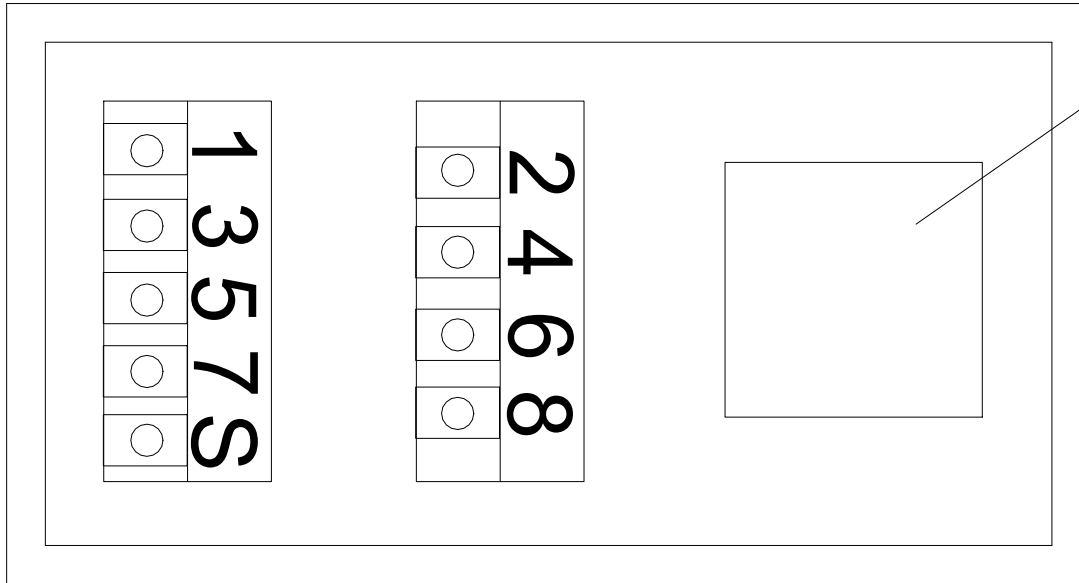

Internal RJ45 Connection

Ethernet cable should be straight through - Pin to Pin
 Twisted pair cable with overall screen should be used
 Termination in accordance with T548B Standard

Connections

- 1 - Orange / White
- 2 - Orange
- 3 - Green / White
- 4 - Blue
- 5 - Blue / White
- 6 - Green
- 7 - Brown White
- 8 - Brown
- S - Cable Screen

SCALE
NTS
FINISH

MATERIAL AND SPECIFICATION

ALL DIMENSIONS ARE IN MILLIMETERS
 UNLESS OTHERWISE STATED
 TOLERANCES UNLESS OTHERWISE STATED
 +0.1
 ANG +0.2

ISSUE	B			
DATE	30-03-21			
TCR				
DRAWN		MJ		
CHECKED		SL		

SHT 2
OF 2

A4



INSTRUMENTATION LTD

PART OF THE  GROUP

TITLE

Wall mounting VPM 4315
Connection detail

DRAWING No

S-001508-VPM-CD

SALES DRAWING ONLY