


REV	DATE	DESCRIPTION	NAME
E	2026-03-15	-	SM

FLANGE (RAISED FACE)	HOLES	PCD (mm)	BOLD SIZE	A (mm)	B MINIMUM (mm)	MATERIAL
DN20 PN16	4	75	M12	105	18	316SS
DN25 PN16	4	85	M12	115	18	316SS
DN40 PN16	4	110	M16	150	18	316SS
DN50 PN16	4	125	M16	165	18	316SS
1" ANSI 150LB	4	79	1/2"	114	18	316SS
1" ANSI 300LB	4	89	5/8"	125	18	316SS
2" ANSI 150LB	4	121	5/8"	152	18	316SS

NOTE:
 FLANGE THICKNESS (B) MUST BE MINIMUM 18mm TO PROVIDE PROTECTION FOR SENSOR DIAPHRAGM. ALL FLANGES SUPPLIED LOOSE FOR CUSTOMER TO FIT. REFER TO INSTRUCTION DRAWING S-001518-APT-DD.
 OTHER FLANGE SIZES ARE AVAILABLE. REFER TO PSM

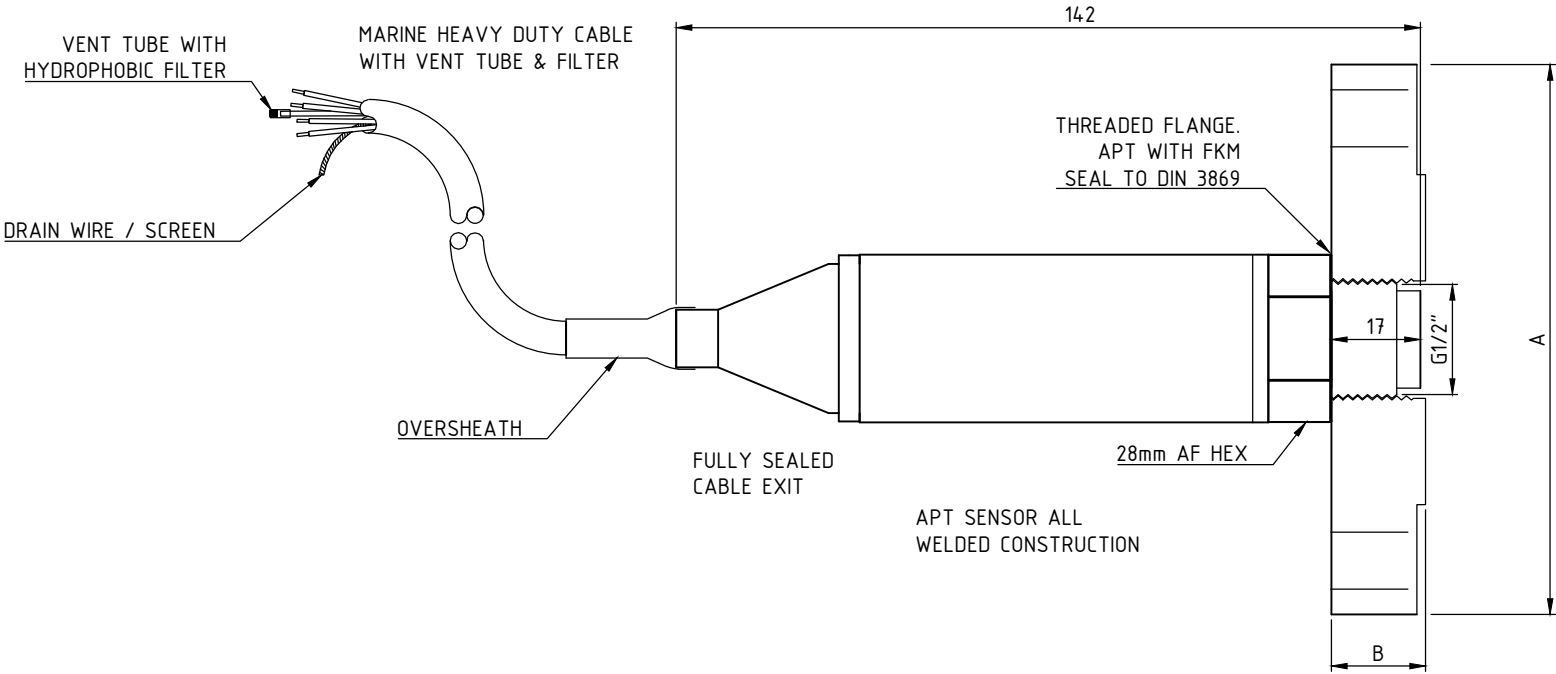

MATERIAL OPTIONS:
 ALL 316 ST/STL
 ALL TITANIUM / FLANGE 316SS
 HASTELLOY PROCESS CONNECTION / TANTALUM DIAPHRAGM / BODY & FLANGE 316SS

FOR CABLE TERMINATION REFER TO DRAWING: S-001479-APT-GA



DESCRIPTION: APT 1000 FLANGE TRANSMITTER	1 ST ANGLE	ISSUED DATE:	ISSUED BY:	REVISION:	WEIGHT:	SCALE:
		2020-06-18	SM	E	-	NTS
		APPROVED DATE:	APPROVED BY:	SHEET:	DRAWING NO:	
		2020-06-18	MJ	1/1	S-001474-APT-DD	
THE COPYRIGHT/OWNERSHIP OF THIS DOCUMENT IS AND WILL REMAIN OURS. THE DOCUMENT MUST NOT BE USED WITHOUT OUR AUTHORIZATION OR BROUGHT TO THE KNOWLEDGE OF A THIRD PARTY						